

# MINI CHP PLANT

CASE STUDY

April 2016

## Mini CHP units at a sports centre Nærum, Denmark



*The system has a payback time of less than 5 years and reduces the CO<sub>2</sub> emission by approx. 133-200 tonnes per year*

### Mini CHP units in combination with a heat pump reduce energy cost and greenhouse gas emission.

With the installation of three mini CHP units and a heat pump, the Rundforbi Sports Centre has successfully reduced cost of electricity and heating while lowering the greenhouse gas emission by approx. 133-200 tonnes per year. The advantage of the CHPs is more efficient fuel use compared to separate

heat and power production. The implementation of a heat pump also includes renewable energy in the heating system and has made it possible to recover waste heat from the ventilation system. The payback time for the complete installation is less than 5 years.

### Short description of the installation

•••

#### The site

The site is a public sports center with facilities for swimming, gym, conference rooms, and athletics stadium.

#### The installation

Consists of three mini CHP units, one brine/water heat pump and two condensing gas boilers. The mini CHP units and heat pump are combined with heat storage. The heat pump recovers heat from the ventilation outlet and renewable heat from ground collectors.

#### Operation strategy

The CHP units should produce as much electricity as possible, without exceeding the facilities' simultaneous own consumption of electricity. Peak-load boilers are used if more heat is needed.

# MINI CHP PLANT

CASE STUDY

April 2016

## The technical part

### Plant data for 1 year's operation

- Installation year	2014
- CHP total operating hours	18,500 hours
- CHP electricity generation	335,000 kWh
- CHP heat output, approx.	736,000 kWh
- Heat pump heat output	164,000 kWh
- Boiler heat output	259,000 kWh


### Financial data

- Installation cost	267,000 EUR
- Payback time	4-5 years

### Installation data

	Model	Units	Specification
- Mini CHP	EC POWER XRGI 20	3	Electricity generation 20 kW per unit Heat capacity 40 kW per unit
- Heat pump	Thermia Robust Eco 42	1	Nominal heat capacity 42 kW
- Gas boiler	Danstoker	2	Heat capacity 600 kW per unit (1 spare)
- Heat storage tanks	EC POWER	4	3 x 1000 l for the mini CHP unit 1 x 500 l for the heat pump

### Energy flows

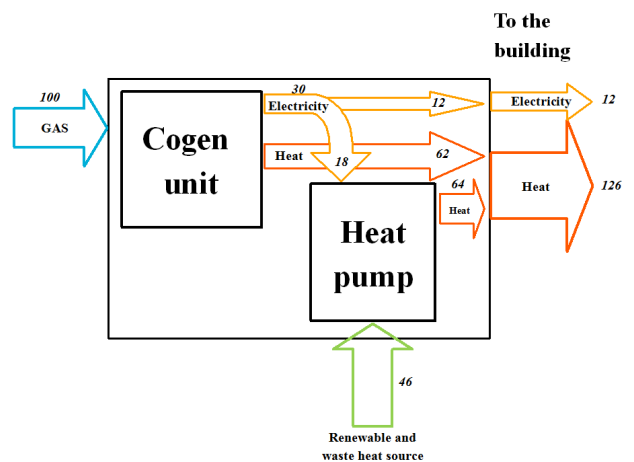

*Illustration of the energy flows from the energy central to the sports facility*

MORE INFORMATION: CONTACT

Your local energy company • Energy advisor • Product supplier

Information collected by

Danish Gas Technology Centre • Dr. Neergaards Vej 5B • 2970 Hørsholm  
tel. +45 2016 9600 • www.dgc.dk • dgc@dgc.dk